



NOTES:

1. AERATOR MODEL 700LL MUST BE USED AND RUN ON A 30 MINUTE ON, 30 MINUTE OFF CYCLE IN EACH TREATMENT CHAMBER
2. J-1250 MUST BE PRECEDED BY 1000 GALLON SEPTIC TANK OR PRETREATMENT TANK
3. DEVELOP RISERS TO GRADE OR WITHIN 12" BELOW GRADE
4. PLASTIC RISERS CAST INTO THE TANK LID MAY BE USED IN PLACE OF CONCRETE RISERS

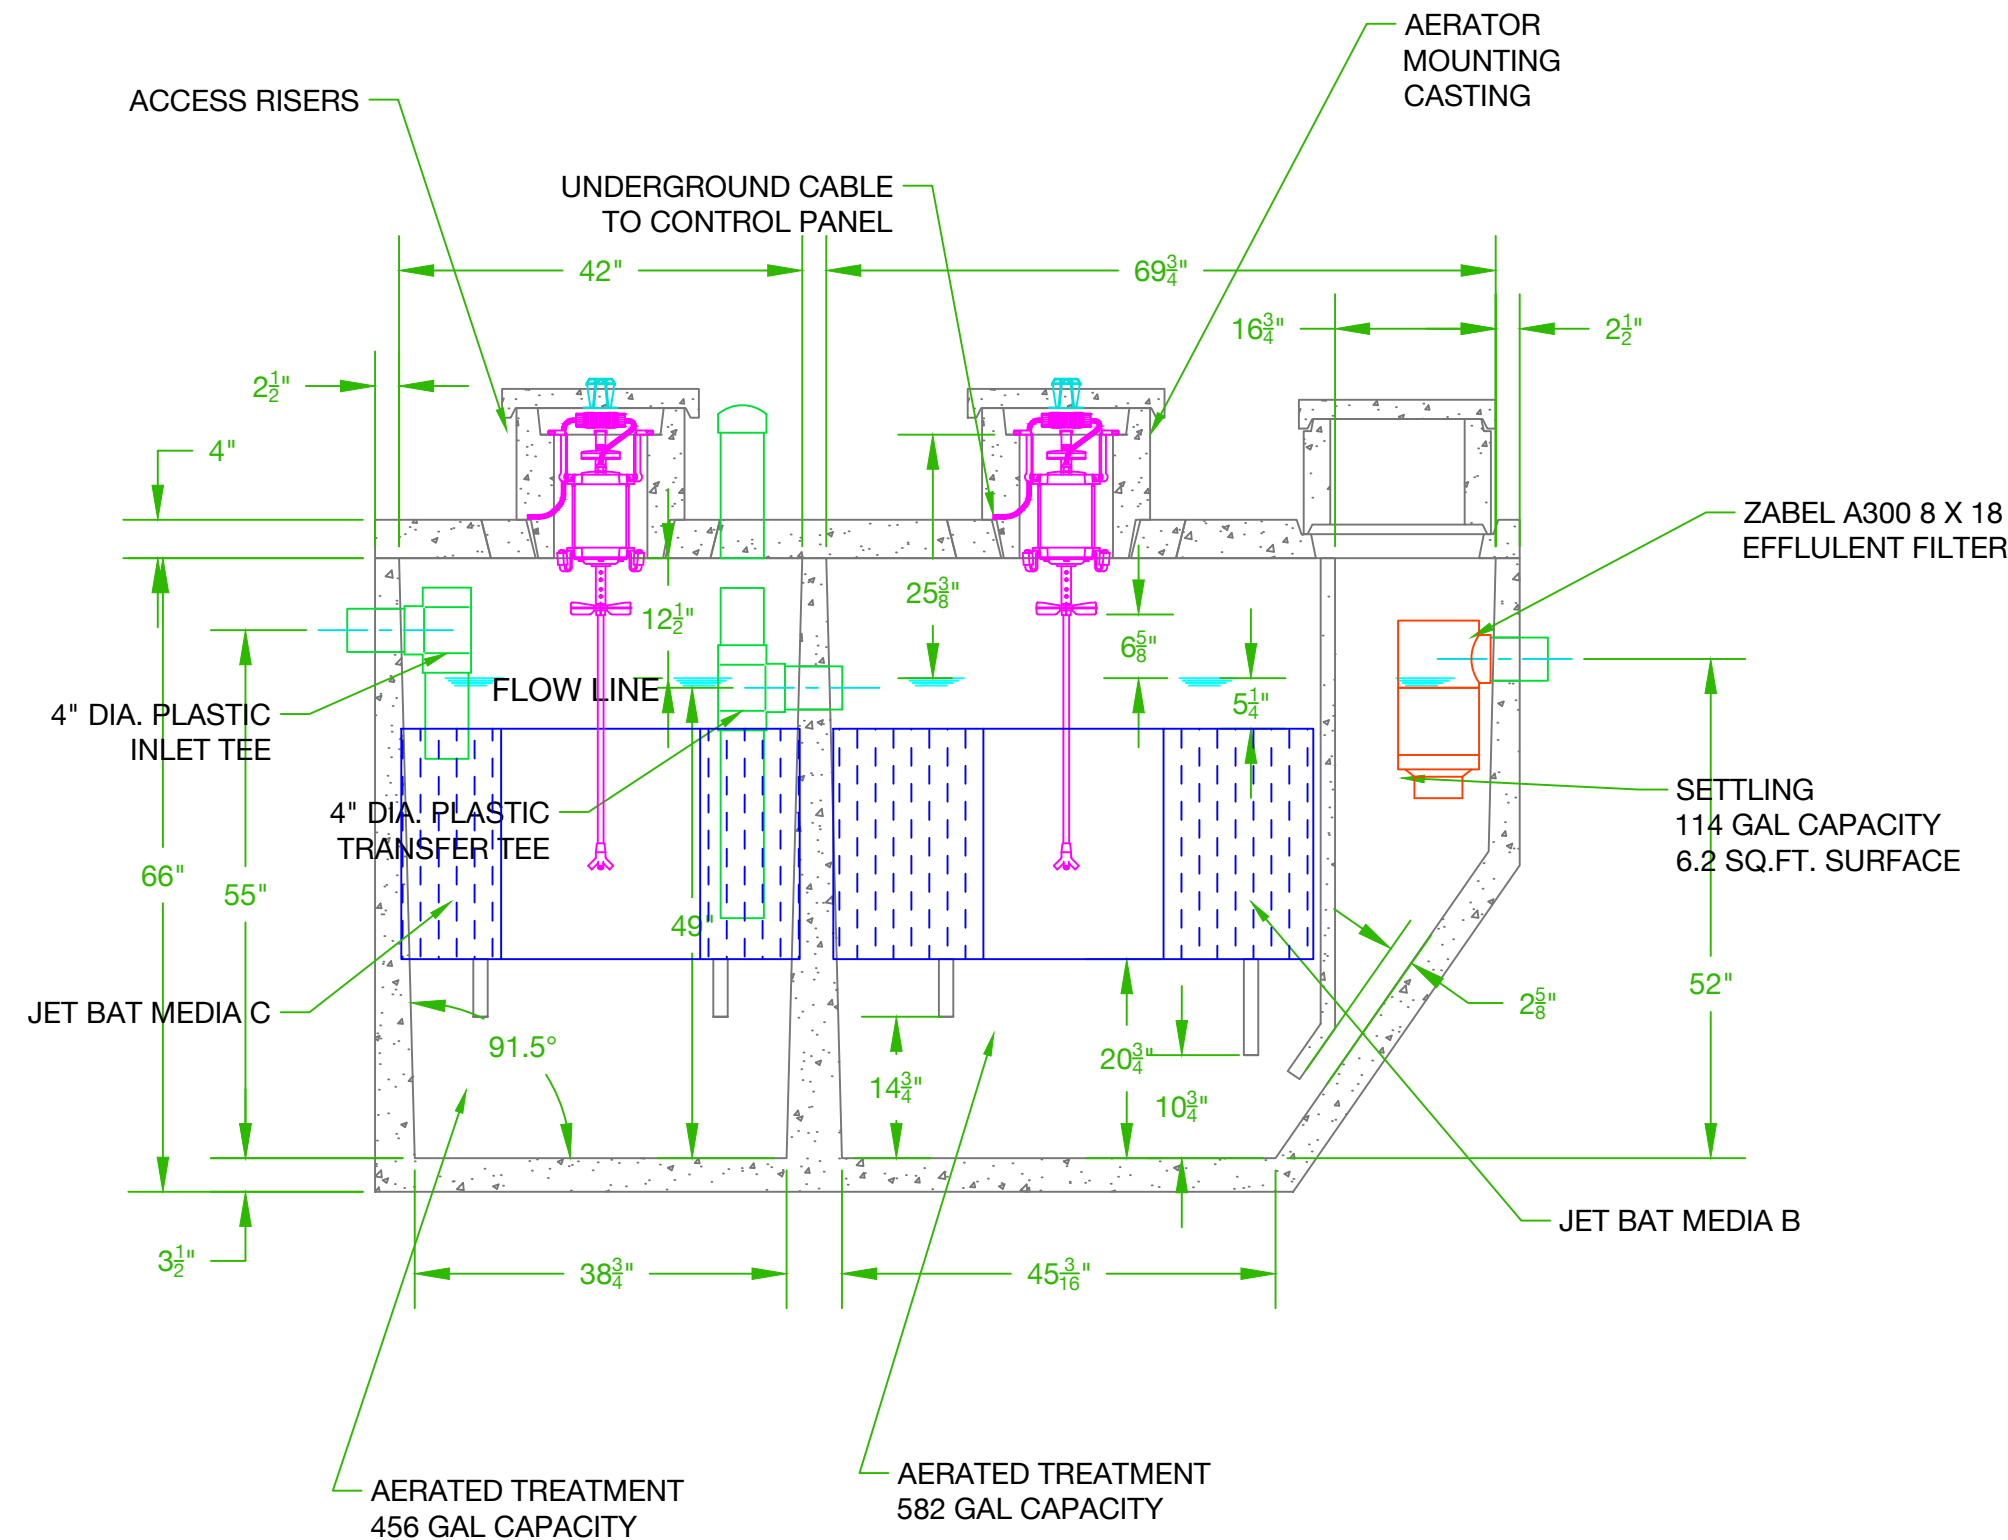

-	1407	3/18/16	NEW DRAWING	N J K
REV	ECN	DATE	DESCRIPTION	DRFT/APRV
			DRAWN BY: N J K	DATE: 3/18/16
TITLE: J-1250 RESIDENTIAL WWTP WITH EFFLUENT FILTRATION ONE PIECE TANK CASTING			APPROVED BY:	DATE:
USED ON:			MATERIAL:	
PROPRIETARY PROPERTY: THIS DRAWING IS THE PROPERTY OF JET INC. AND MAY NOT BE REPRODUCED, COPIED OR USED WITHOUT WRITTEN PERMISSION.			DRAWING NUMBER: J-1250CF	REV: -
			SCALE: 1 : 20	SIZE: C
			UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS ARE IN INCHES DECIMAL: ± .005 FRACTIONAL: ± 1/64 DEGREE: ± 1°	