



NOTES:

1. AERATOR MODEL 700LL MUST BE USED IN CONTINUOUS OPERATION IN EACH TREATMENT CHAMBER
2. J-1000 MUST BE PRECEDED BY 1000 GALLON SEPTIC TANK OR PRETREATMENT TANK
3. DEVELOP RISERS TO GRADE OR WITHIN 12" BELOW GRADE
4. PLASTIC RISERS CAST INTO THE TANK LID MAY BE USED IN PLACE OF CONCRETE RISERS

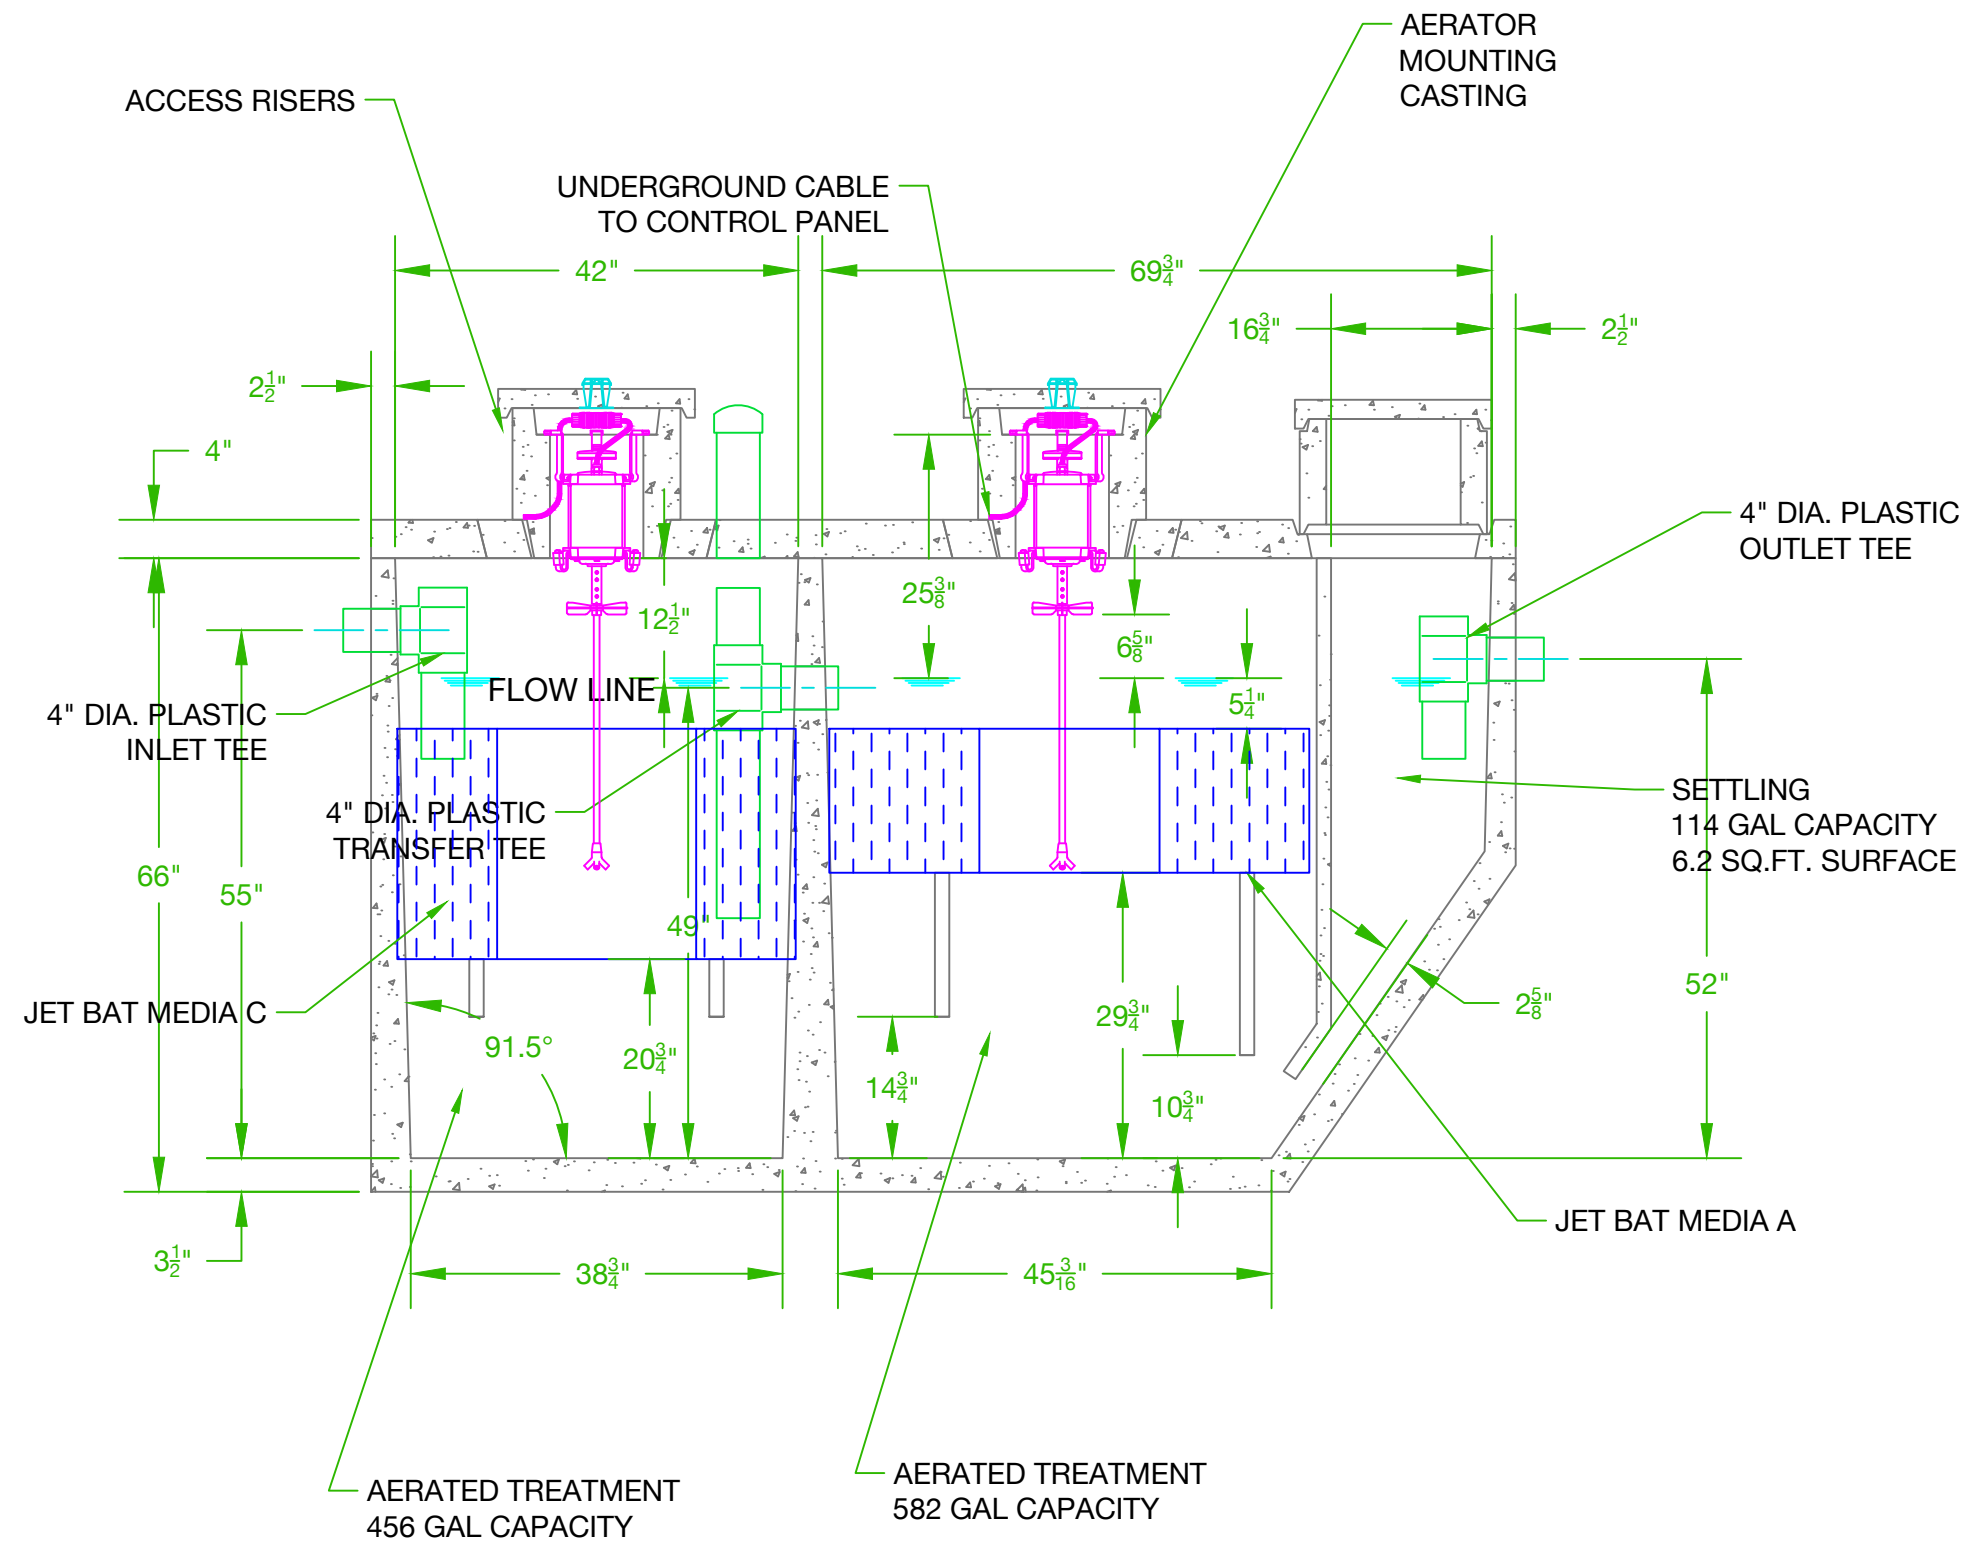

-	1407	08/14/14	REDRAWN	N J K
REV	ECN	DATE	DESCRIPTION	DRFT/APRV
		DRAWN BY: N J K	DATE: 08/14/14	
		APPROVED BY:	DATE:	
TITLE:		MATERIAL:		
J-1000 RESIDENTIAL WWTP ONE PIECE TANK CASTING		SCALE: 1 : 20	SIZE: C	
USED ON:		UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS ARE IN INCHES DECIMAL: ± .005 FRACTIONAL: ± 1/64 DEGREE: ± 1°		
PROPRIETARY PROPERTY: THIS DRAWING IS THE PROPERTY OF JET INC. AND MAY NOT BE REPRODUCED, COPIED OR USED WITHOUT WRITTEN PERMISSION.		DRAWING NUMBER: J-1000		
				REV: -